Machine History Viewer For The Integrated Computer Control System Of The National Ignition Facility*

R. Wilson, J. Hoffman, J. Mauvais

October 4, 2013

Disclaimer

This document was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor Lawrence Livermore National Security, LLC, nor any of their employees makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or Lawrence Livermore National Security, LLC. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or Lawrence Livermore National Security, LLC, and shall not be used for advertising or product endorsement purposes.

Machine History Viewer for the Integrated Computer Control System of the National Ignition Facility*

Rick Wilson, James Hoffman, Jessica Mauvais, LLNL, Livermore, CA 94550, USA

Abstract

The Machine History Viewer (Figure 1) is a recently developed capability of the Integrated Computer Control System (ICCS) software to the National Ignition Facility (NIF) that introduces the capability to analyze machine history data to troubleshoot equipment problems and to predict future failures. Flexible time correlation, text annotations, and multiple y-axis scales will help users determine cause and effect in the complex machine interactions at work in the NIF. Report criteria can be saved for easy modification and reuse. Integration into the already-familiar ICCS GUIs makes reporting easy to access for the operators. Reports can be created that will help analyze trends over long periods of time that lead to improved calibration and better detection of equipment failures. Faster identification of current failures and anticipation of potential failures will improve NIF availability and shot efficiency.   A standalone version of this application is under development that will provide users remote access to real-time data and analysis allowing troubleshooting by experts without requiring them to come on-site.

The architecture and functionality of the Machine History Viewer will be presented along with examples.
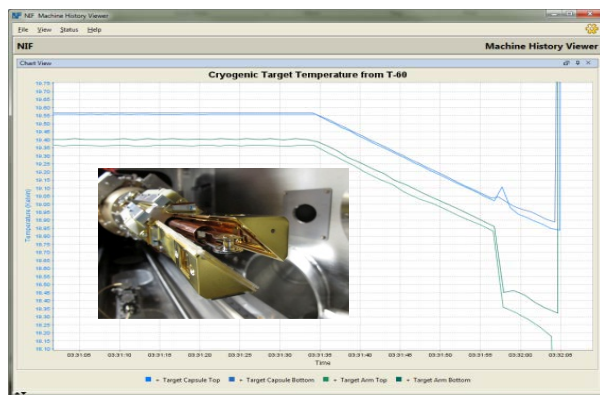
Figure 1 - Chart showing temperature of NIF target for 60 seconds prior to shot. Shroud (inset photo) opened at T-8 seconds, causing rise in temperature, compensated for by lowering temperature of the target holder.

BACKGROUND

The NIF [1,2] control system includes about 40,000 individual devices, including over 10,000 motors. Many of these devices leave a record of their actions and readings in the machine history database. Examples include motor position and velocity, binary output commanded position and temperature sensor readings. As a whole, NIF presently has over 300 million rows of machine history data, and the archive grows by over 14 million rows each month. This data is valuable for understanding the behavior of the system, for troubleshooting, prediction of problems before they occur, and system optimization. The challenge is to enable the users to access this data in a convenient fashion, and to present the results in a useful, easy-to-understand display.
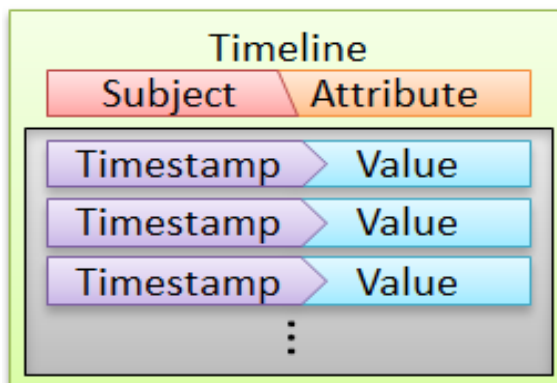

Figure 2 – Timeline Structure

TERMINOLOGY

Individual providers of machine history (e.g. motors) are called *Timeline Sources*, and are identified with *Source Names*. Each type of source may have different *Attributes* (e.g., position and velocity for the motor). The *Value* of the attribute may be a number or text (or soon to be image). A *Timeline* (Figure 2) is an ordered list of time stamps and Values for a specific Source Name and Attribute. For example, the list of all motor positions for a specific motor for the past hour would be a timeline.

USE CASES

The Machine History Viewing Tools are used by system operators, scientists, engineers and technicians. System operators gain situational awareness from recent history (e.g., temperature or position plots). Scientists can improve system alignment accuracy by identifying interferences such as heat from chamber illumination sources. Engineers and technicians can troubleshoot system problems and design efficiency improvements for future upgrades. Engineers can also observe trends in system behavior which will allow repairs or service to be performed before a system failure occurs (Figure 3).
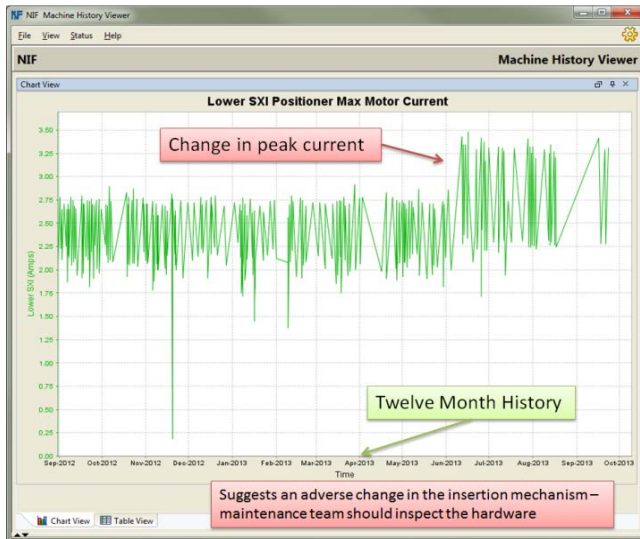

Figure 3 – Chart showing maximum motor current per move, for one year, for the Lower Static X-ray Imager insertion motor.

USER PRESENTATION

Strip Chart: The Machine History Viewer uses a strip chart display as its primary presentation. This is a standard view for time-based data, and is particularly useful when correlating different device behavior over the same period. The chart view allows multiple timelines on the same display. It also allows live updating with horizontal scrolling (much line an analog strip chart device). The strip chart allows zooming, panning, and auto-scaling, all with mouse movements. Clicking the legend for specific timelines will hide or show that timeline on the chart. Hovering over any data point will show a tooltip with the date/time and value for the point.

Table View: Also available is a table-view, showing the timeline values in an Excel-like grid. The table view is better for seeing specific data values, or series of values. The table can be sorted on any column and can contain both numeric and text values. Users can also export the table data to an Excel file. The export contains an initial sheet of the combined data, and then individual sheets for each timeline. The combined sheet usually contains many blank cells, since it's time-correlated and not all devices archive history at the same time. The individual sheets don't have gaps, which simplifies their use in Excel for plotting or sorting.

MULTIPLE VERTICAL SCALE

A problem in simple strip chart displays is that if multiple timelines are shown on the same chart, the timeline with the greatest range of values dominates the scale. For example, if the chart shows a motor with a range 0 to 7000 mm, and the same chart shows a brake (on/off) with a range of 0 to 1, the brake will appear as a straight line, because the vertical scale will be 0 to 7000. The Viewer solves this problem by supporting multiple vertical scales. Now the chart can have two scales, one for the motor and one for the brake, and the changes to each will be clear (Figure 3). The Viewer is flexible in that any timeline can be assigned to any scale. So if there are multiple devices sharing a similar range of values, they can be plotted against a shared scale. Scales can be depicted on the left, or right, or both sides of the chart.

Figure 3 - Chart with multiple Y-scale. In this chart, we see a motor's position, velocity, and the position of the parking brake. The motor range is 7000 mm, the velocity 150 and the brake zero to one. In the Machine History Viewer, the user has full control over all scales, labels and colors on the chart.

SPECIFYING REPORTS CRITERIA

Multiple interfaces are available to view NIF machine history.

Device Control Panel: Each NIF device has a maintenance or control panel. For example, there is a GUI which can be used to control each of the NIF motors. The ICCS control system has a rich navigation system to access the device control panels, and the system operators are very comfortable finding the control panels. The control panel framework now has a menu option to show the machine history for that device. The history panel (Figure 4) prompts the user for the time frame, but otherwise already knows the source name, and automatically displays the timelines for all attributes for that source.

To correlate timelines from multiple devices, the operator can open the control panel history for another device, and drag a timeline from one chart to another.
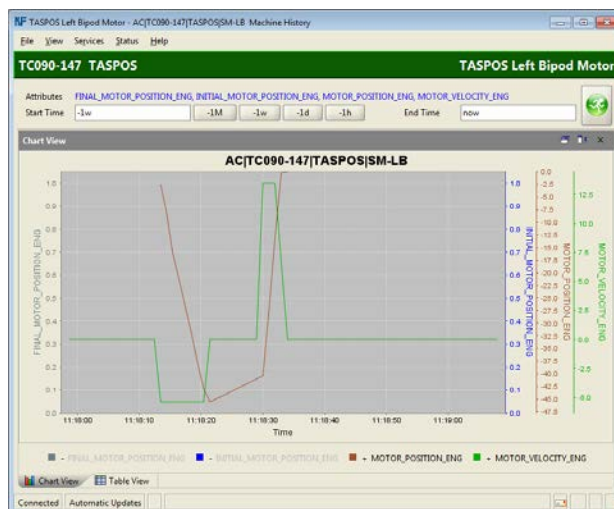

Figure 4 – Chart generated using the Target Alignment Sensor left bipod motor Device Control Panel. All attributes for the devices are shown by default, but the user has clicked to hide the first two attributes in this example.

History Report Wizard: For full control over the report, a report wizard tool is available. This provides an editor where users specify which vertical scales they want, and which timelines should be assigned to each scale. Timeline and scale legends and colors may all be specified through the wizard, but defaults are provided for all. Once the report is generated, the editor can be used to modify or extend the report.

Report Criteria Files: Users can save any report setup (without the timeline data itself) to a report criteria file. This file contains the full report specification, with time range, source names, attribute names, scales and legends, etc. This file can be drag/dropped onto the standalone report writer to quickly re-run any saved report. These files can also have relative time ranges. For example, a report could show NIF target temperatures for the past 24 hours. These text files are stored in YAML format [3], which is computer-readable but also easy for people to read and modify with a text editor.

SYSTEM ARCHITECTURE

The system is designed (Figure 5) to accept history data from virtually any source, and to allow it to be displayed in any fashion. Specific modules are implemented to read from the NIF machine history tables and other history text files.

The timeline repository is the gateway to the timeline sources: the single interface for software modules which want to access the timeline data.

Utility methods are provided to repackage timeline data, to simplify the work in the GUIs. For example, the strip charts are implemented using JFreeChart [4], which has its own data structures. A utility method is provided which will convert a set of timelines into a JFreeChart object, ready for display.

The design makes it easy to add support for new data sources without any changes to the GUIs, and to add new GUIs or other consumers without making changes to the timeline sources.
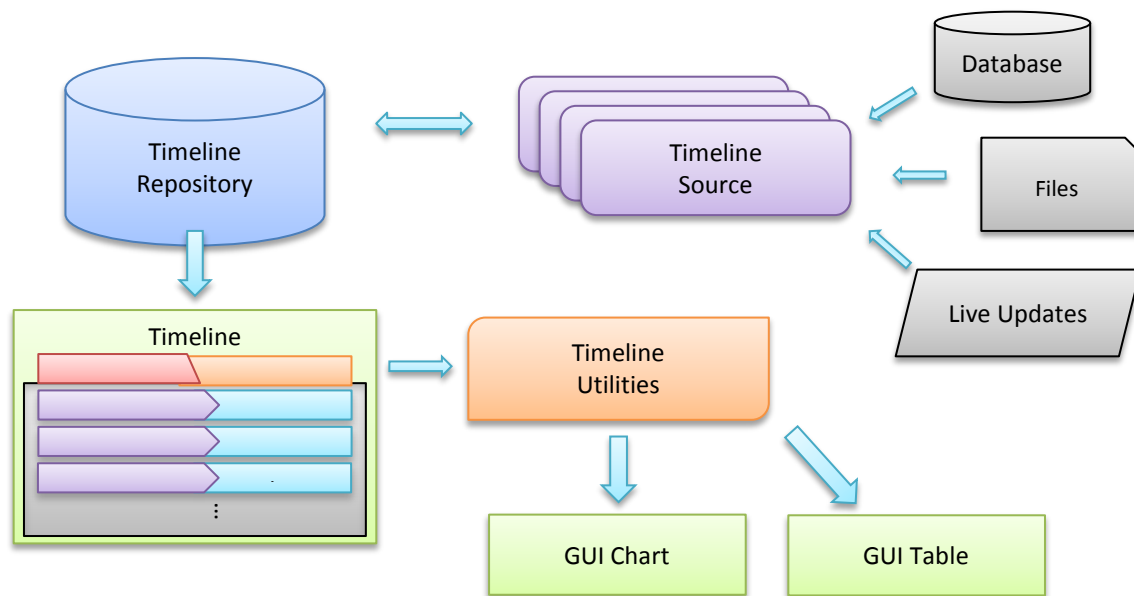
Figure 5 – Machine History high level design, showing independence of timeline sources and GUIs. The timeline repository is a gateway to the data sources, but does not mirror the data.

SUMMARY

The NIF Control System Machine History Viewer tool is a new capability which should provide many benefits to the operation and maintenance of the NIF system. Immediate history helps operators understand present context of the devices. Recent history helps scientists and engineers troubleshoot problems discovered during operations. Long-term history helps predict failures before they occur, so maintenance and repairs can be performed without impacting the shots.

By building with a flexible architecture, the system can be extended at minimal cost. New timeline sources can be added without changing the GUIs, and new GUIs can be added without affecting the timeline sources.

ACKNOWLEDGEMENTS

REFERENCES

[1] E. Moses, et al., "The National Ignition Facility: Path to Ignition in the Laboratory," Fourth International Conference on Fusion Sciences and Applications," Biarritz, France, September 2005.
[2] The National Ignition Facility Web site, https://lasers.llnl.gov
[3] YAML web site, http://www.yaml.org/
[4] JFreeChart web site, http://www.jfree.org/jfreechart/